


# Parallel Meter & Load Management Control Wiring Diagram



Your Touchstone Energy® Cooperatives

P.O. BOX 575, Cornell, WI 54732  
 (715) 239-6800 / Fax 239-6160  
 800-300-6800

**CHIPPEWA VALLEY  
 ELECTRIC  
 COOPERATIVE**

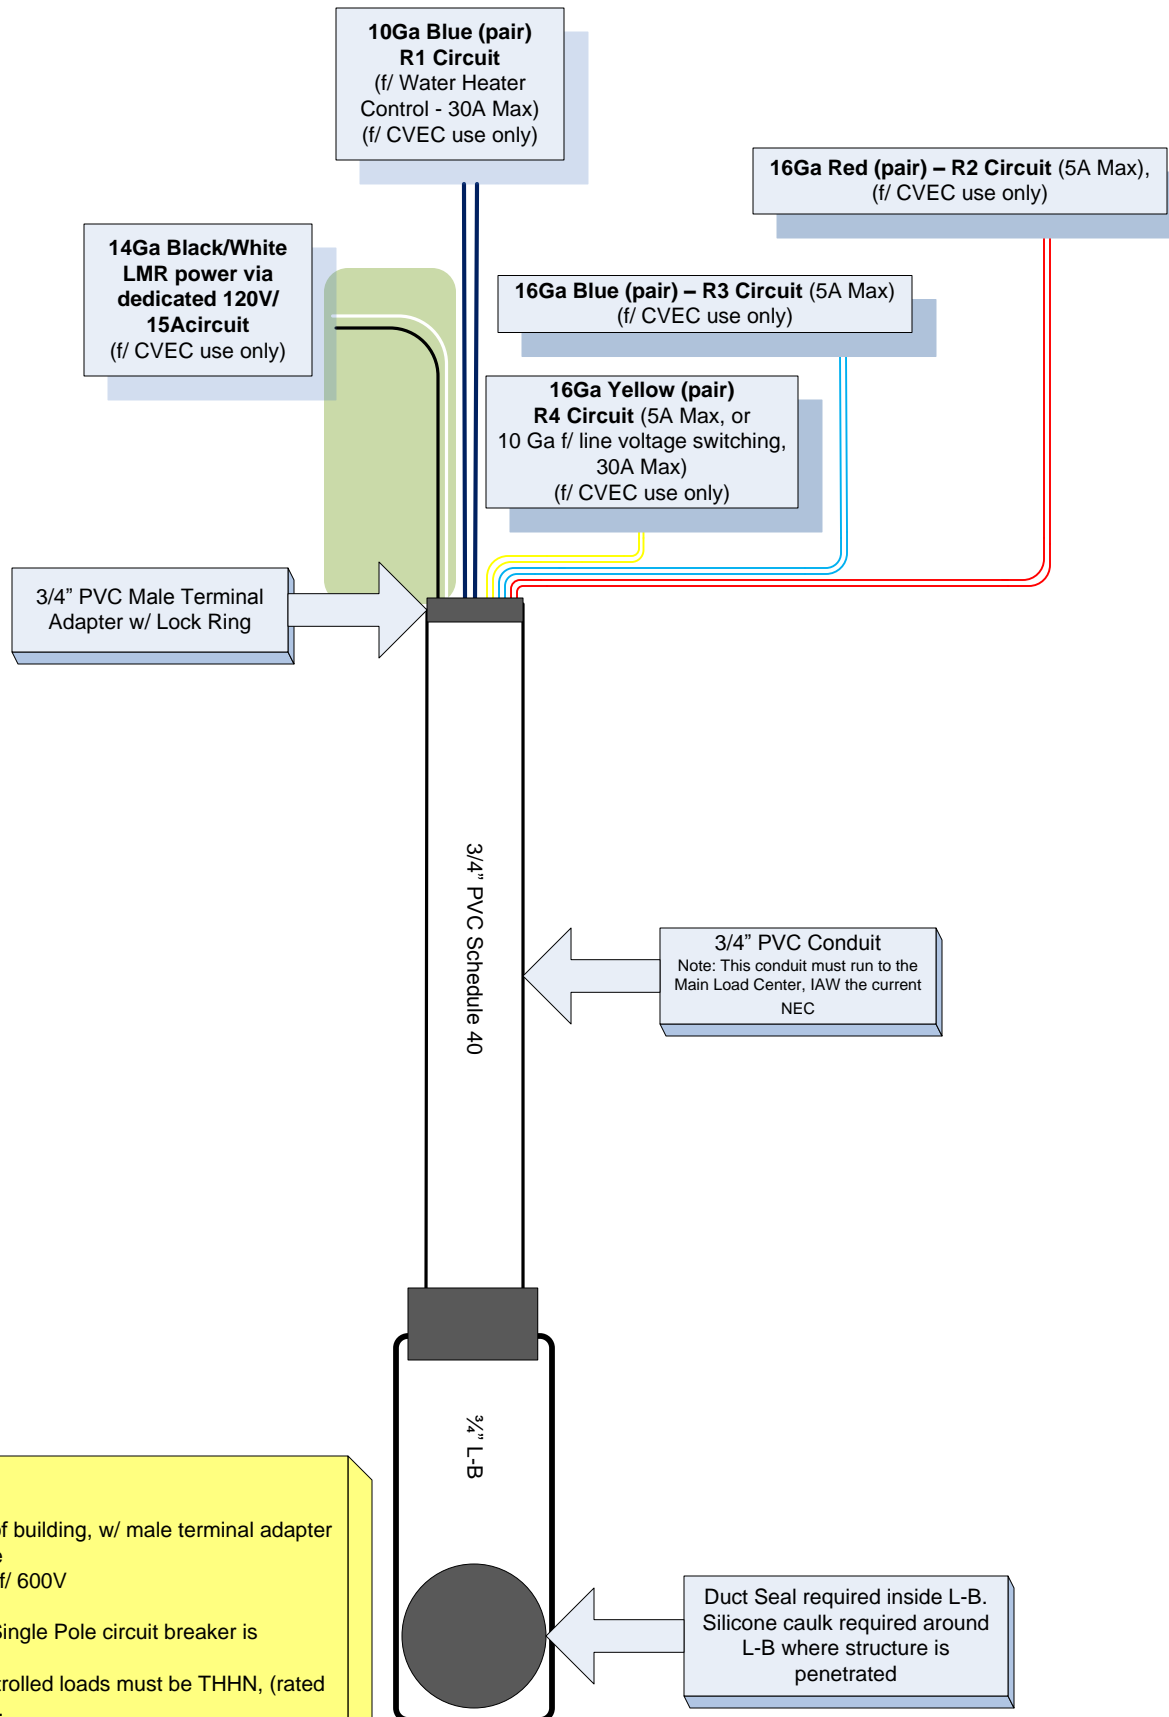

**Notes**

- 1) 3/4" PVC Conduit shall end outside of building, w/ male terminal adapter & lock ring at 55" above finish grade
- 2) All wires shall be type THHN, rated f/ 600V
- 3) Leave 12" tails on all leads
- 4) Member Supplied -Dedicated 15A Single Pole circuit breaker is required. (Black & White wires)
- 5) Wire from Main Load Center to controlled loads must be THHN, (rated f/ 600V), in conduit, and/or type NM.