

200 Amp 277/480 Three Phase

- Rate Schedule M or X
- Transformer Size (150 KVA)
- Voltage-277/480

- Location to be determined at meeting


- Meter Height at Approx. 60"
- Ground to NEC and WI Comm 16
- Post- Minimum of 6" x 6" treated buried min. 3' in ground
- Backboards-5/4 Treated deck boards or larger (Must be new material, no plywood)

Chippewa Valley Supplies

- Meter Socket
- Milbank # TS-TR-L-1 13 Terminal
- Transformer/Cement Pad/Ground Sleeve
- Meter
- Bar Type CT's
- PT's
- Secondary Wire (1 run of 4/0 Aluminum for each 200 amps)

Member Supplies

- CT Cabinet
- AMP (American Midwest Power)
400 amp is Cat #WMCT4-4L
- Service Rated Disconnect/Overload Protection with appropriate FCI Rating (Must be UL Listed)
- Grounds
- Conduit back to transformer

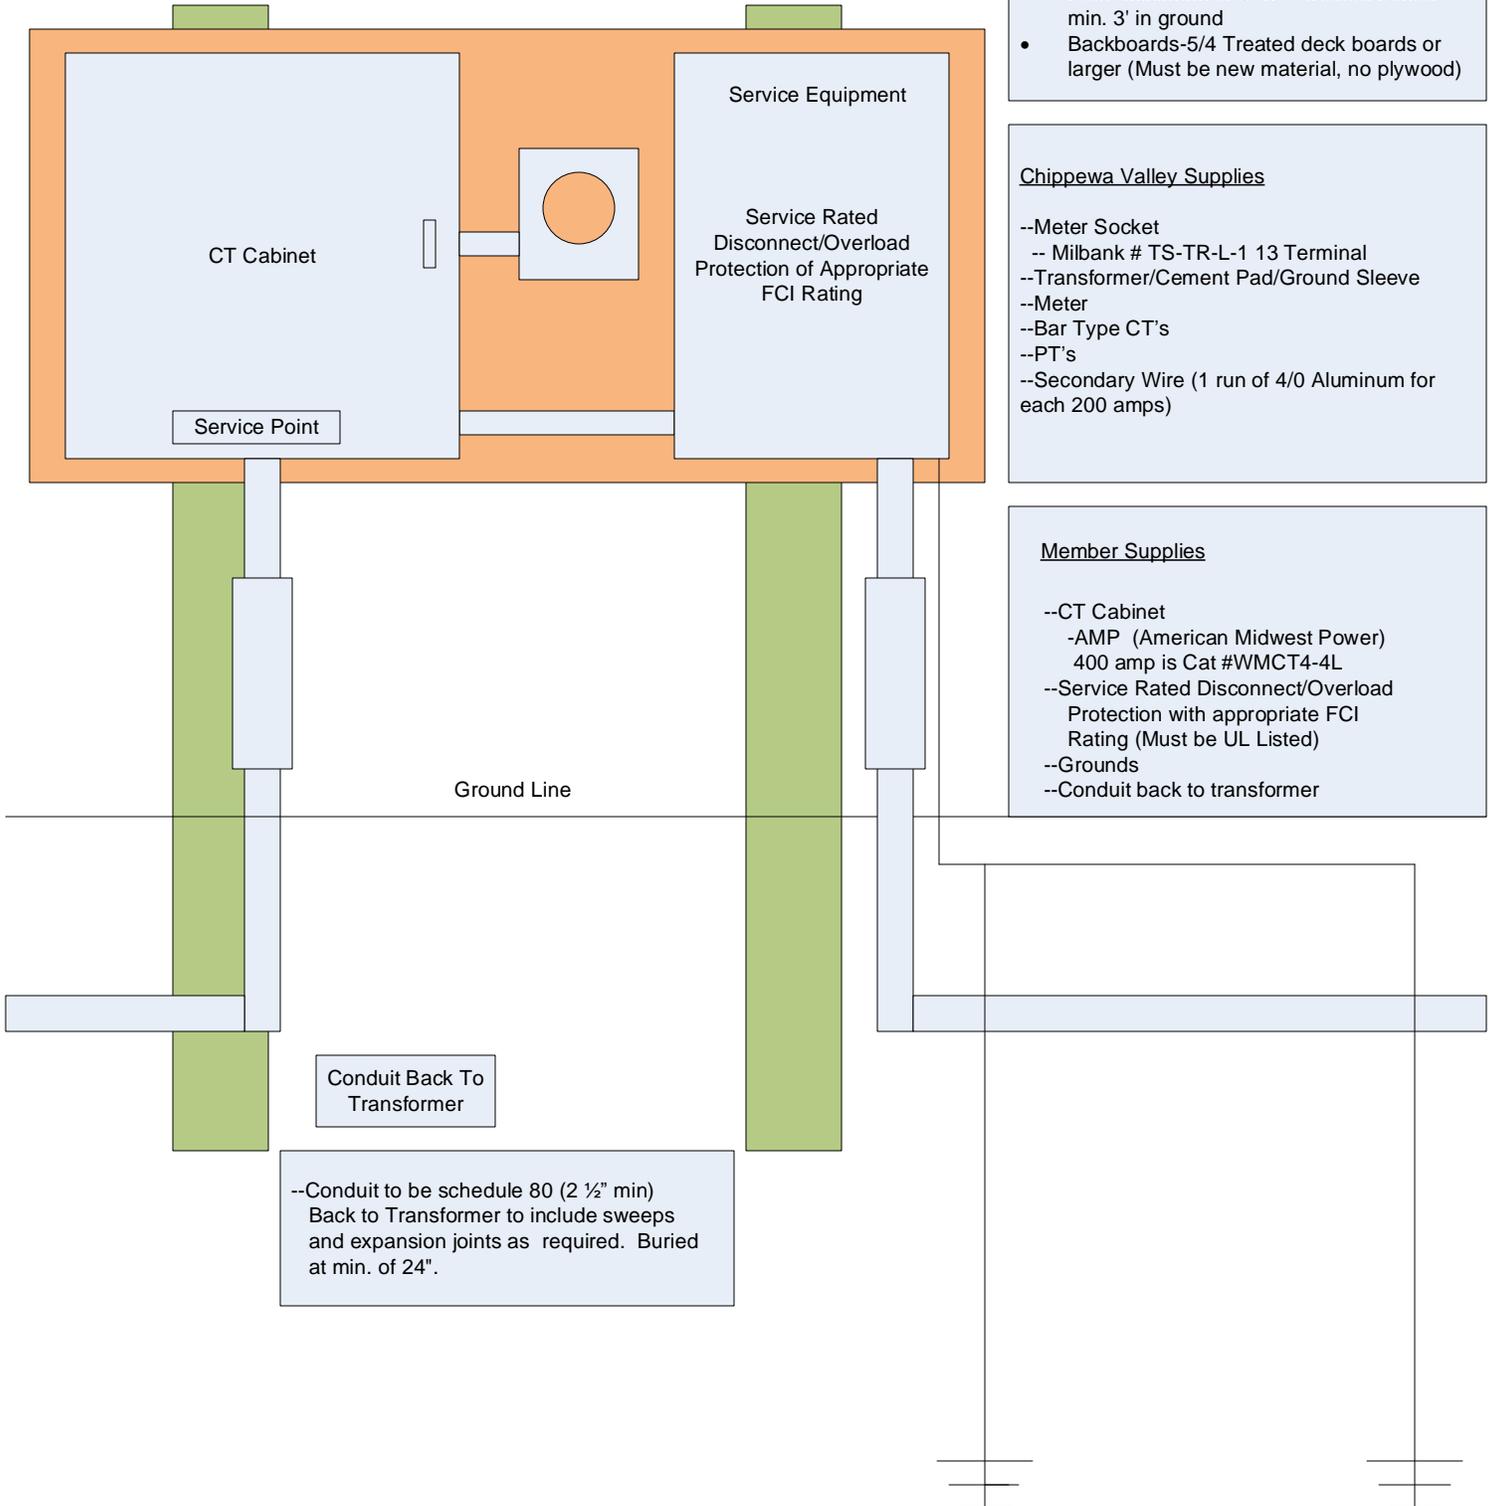

Conduit Back To Transformer

- Conduit to be schedule 80 (2 1/2" min) Back to Transformer to include sweeps and expansion joints as required. Buried at min. of 24".